


System No. W-L-7280



ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Ratings - 1 and 2 Hr (See Item 1)	F Ratings - 1 and 2 Hr (See Item 1)
T Ratings - 1 and 2 Hr (See Item 1)	FT Ratings - 1 and 2 Hr (See Item 1)
L Rating At Ambient - Less Than 1 CFM/ft2	FH Ratings - 1 and 2 Hr (See Item 1)
L Rating At 400 F - Less Than 1 CFM/ft2	FTH Ratings - 1 and 2 Hr (See Item 1)
	L Rating At Ambient - Less Than 5.1 L/s/m2
	L Rating At 204 C - Less Than 5.1 L/s/m2

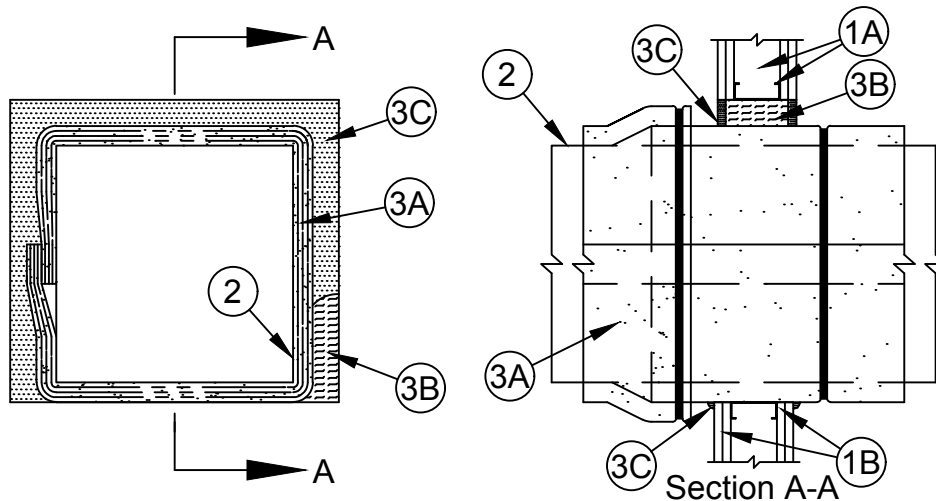

1. **Wall Assembly** - The 1 or 2 hr fire-rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U400, V400 or W400 Series Wall and Partition Design in the Fire Resistance Directory and shall include the following construction features:
 - A. **Studs** - Wall framing shall consist of min 3-1/2 in. (89 mm) wide channel shaped steel studs spaced max 24 in. (610 mm) OC. Additional framing members shall be installed in stud cavity to form a rectangular box around the penetrant.
 - B. **Gypsum Board*** - 5/8 in. (16 mm) thick with square or tapered edges. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual Wall and Partition Design. Max area of opening is 78 ft.2 (7.3 m2) with a max dimension of 107 in. (272 cm).

The hourly F, T, FT, FT and FTH Ratings of the firestop system are equal to the hourly fire rating of the wall assembly in which it is installed.
2. **Steel Air Duct** - One steel duct to be installed within the firestop system. Duct to be rigidly supported on both sides of wall assembly. Min 26 gauge (0.5 mm) galv steel duct having a max perimeter dimension of 400 in. (10.16 m) and a max individual dimension of 100 in. (25.4 m).
3. **Firestop System** - The firestop system shall consist of the following:
 - A. **Duct Wrap Materials*** - Nom 1-1/2 in. (38 mm) thick blanket totally encapsulated within foil-scrim facers. The steel air duct shall be wrapped with one layer of duct wrap installed in accordance with Ventilation Assembly Nos. V-32, V-34 or V-36. See Ventilation Duct Assemblies in Vol. 2 of the Fire Resistance Directory. When steel angles (Item 3D) are used, the edges of the duct wrap material are to about the protruding leg of the angle and the tight seam is to be covered with an additional 6 in. (152 mm) wide "collar" of duct wrap. The annular space between the insulated duct and the periphery of the opening shall be min 0 in. (point contact) to max 2 in. (51 mm).

UNIFRAX I LLC - FyreWrap Elite 1.5 Duct Insulation



Specified Technologies Inc. 210 Evans Way Somerville, NJ 08876

Reproduced courtesy of Underwriters Laboratories, Inc.
Created or Revised: November 9, 2018



A1. **Duct Wrap Materials*** - (Not Shown) - As an alternate to Item 3A, nom 1-1/2 in. (38 mm) thick blanket totally encapsulated within foil-scrim facers. The steel air duct shall be wrapped with two layers of duct wrap installed in accordance with Ventilation Assembly No. V-36. See Ventilation Duct Assemblies in Vol. 2 of the Fire Resistance Directory. When steel angles (Item 3D) are used, the edges of the duct wrap material are to about the protruding leg of the angle and the tight seam is to be covered with an additional 6 in. (152 mm) wide "collar" of duct wrap. The annular space between the insulated duct and the periphery of the opening shall be min 0 in. (0 mm, point contact) to max 2 in. (51 mm).

UNIFRAX I LLC - FyreWrap Elite 1.5 Duct Insulation

B. **Packing Material** - Min 3-1/2 in. (89 mm) and 4-3/4 in. (121 mm) thickness of unfaced scrap duct wrap material or min 4 pcf (64 kg/m³) mineral wool batt insulation firmly packed into the opening as a permanent form for 1 and 2 hr rated walls, respectively. Packing material to be recessed from both surfaces of wall as required to accommodate the required thickness of fill material (Item 3C).

C. **Fill, Void or Cavity Material*- Sealant** - Min 5/8 in. (16 mm) thickness of fill material applied within annulus, flush with both surfaces of wall assembly. A min 1/4 in. (6 mm) diam bead of sealant shall be applied at the gypsum board/insulated duct interface on both surfaces of wall assembly.

SPECIFIED TECHNOLOGIES INC - SpecSeal Series SSS Sealant, SpecSeal LC150 Sealant, SpecSeal LCI Sealant or SpecSeal SIL300 Sealant

D. **Retaining Angles** - (Not Shown) -When dimensions of duct exceed 84 by 84 in. (213 by 213 cm), min No. 16 gauge (0.059 in. or 1.5 mm thick) galv steel angles sized to lap steel duct a min of 2 in. (51 mm) and to lap wall surfaces a min of 1 in. (25 mm) shall be attached to steel duct. Angles attached to steel duct on both sides of wall within 1 in. (25 mm) of wall with min No. 10 by 1/2 in. (13 mm) long steel sheet metal screws or welds located a max of 1 in. (25 mm) from each end of steel duct and spaced a max of 6 in. (152 mm) OC.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Specified Technologies Inc. 210 Evans Way Somerville, NJ 08876

Reproduced courtesy of Underwriters Laboratories, Inc.

Created or Revised: November 9, 2018

(800)992-1180 • (908)526-8000 • FAX (908)231-8415 • E-Mail:techserv@stifirestop.com • Website:www.stifirestop.com



W-L-7280
PAGE 2 OF 2